

GRMS

Guest Room Management System

Drawing

Version

Date

BASIC

2.2.0

20/3/2026

Supplier


Customer

Robotina


OIC Hrpelje 38

6240 Kozina, Slovenia








info@robotina.com

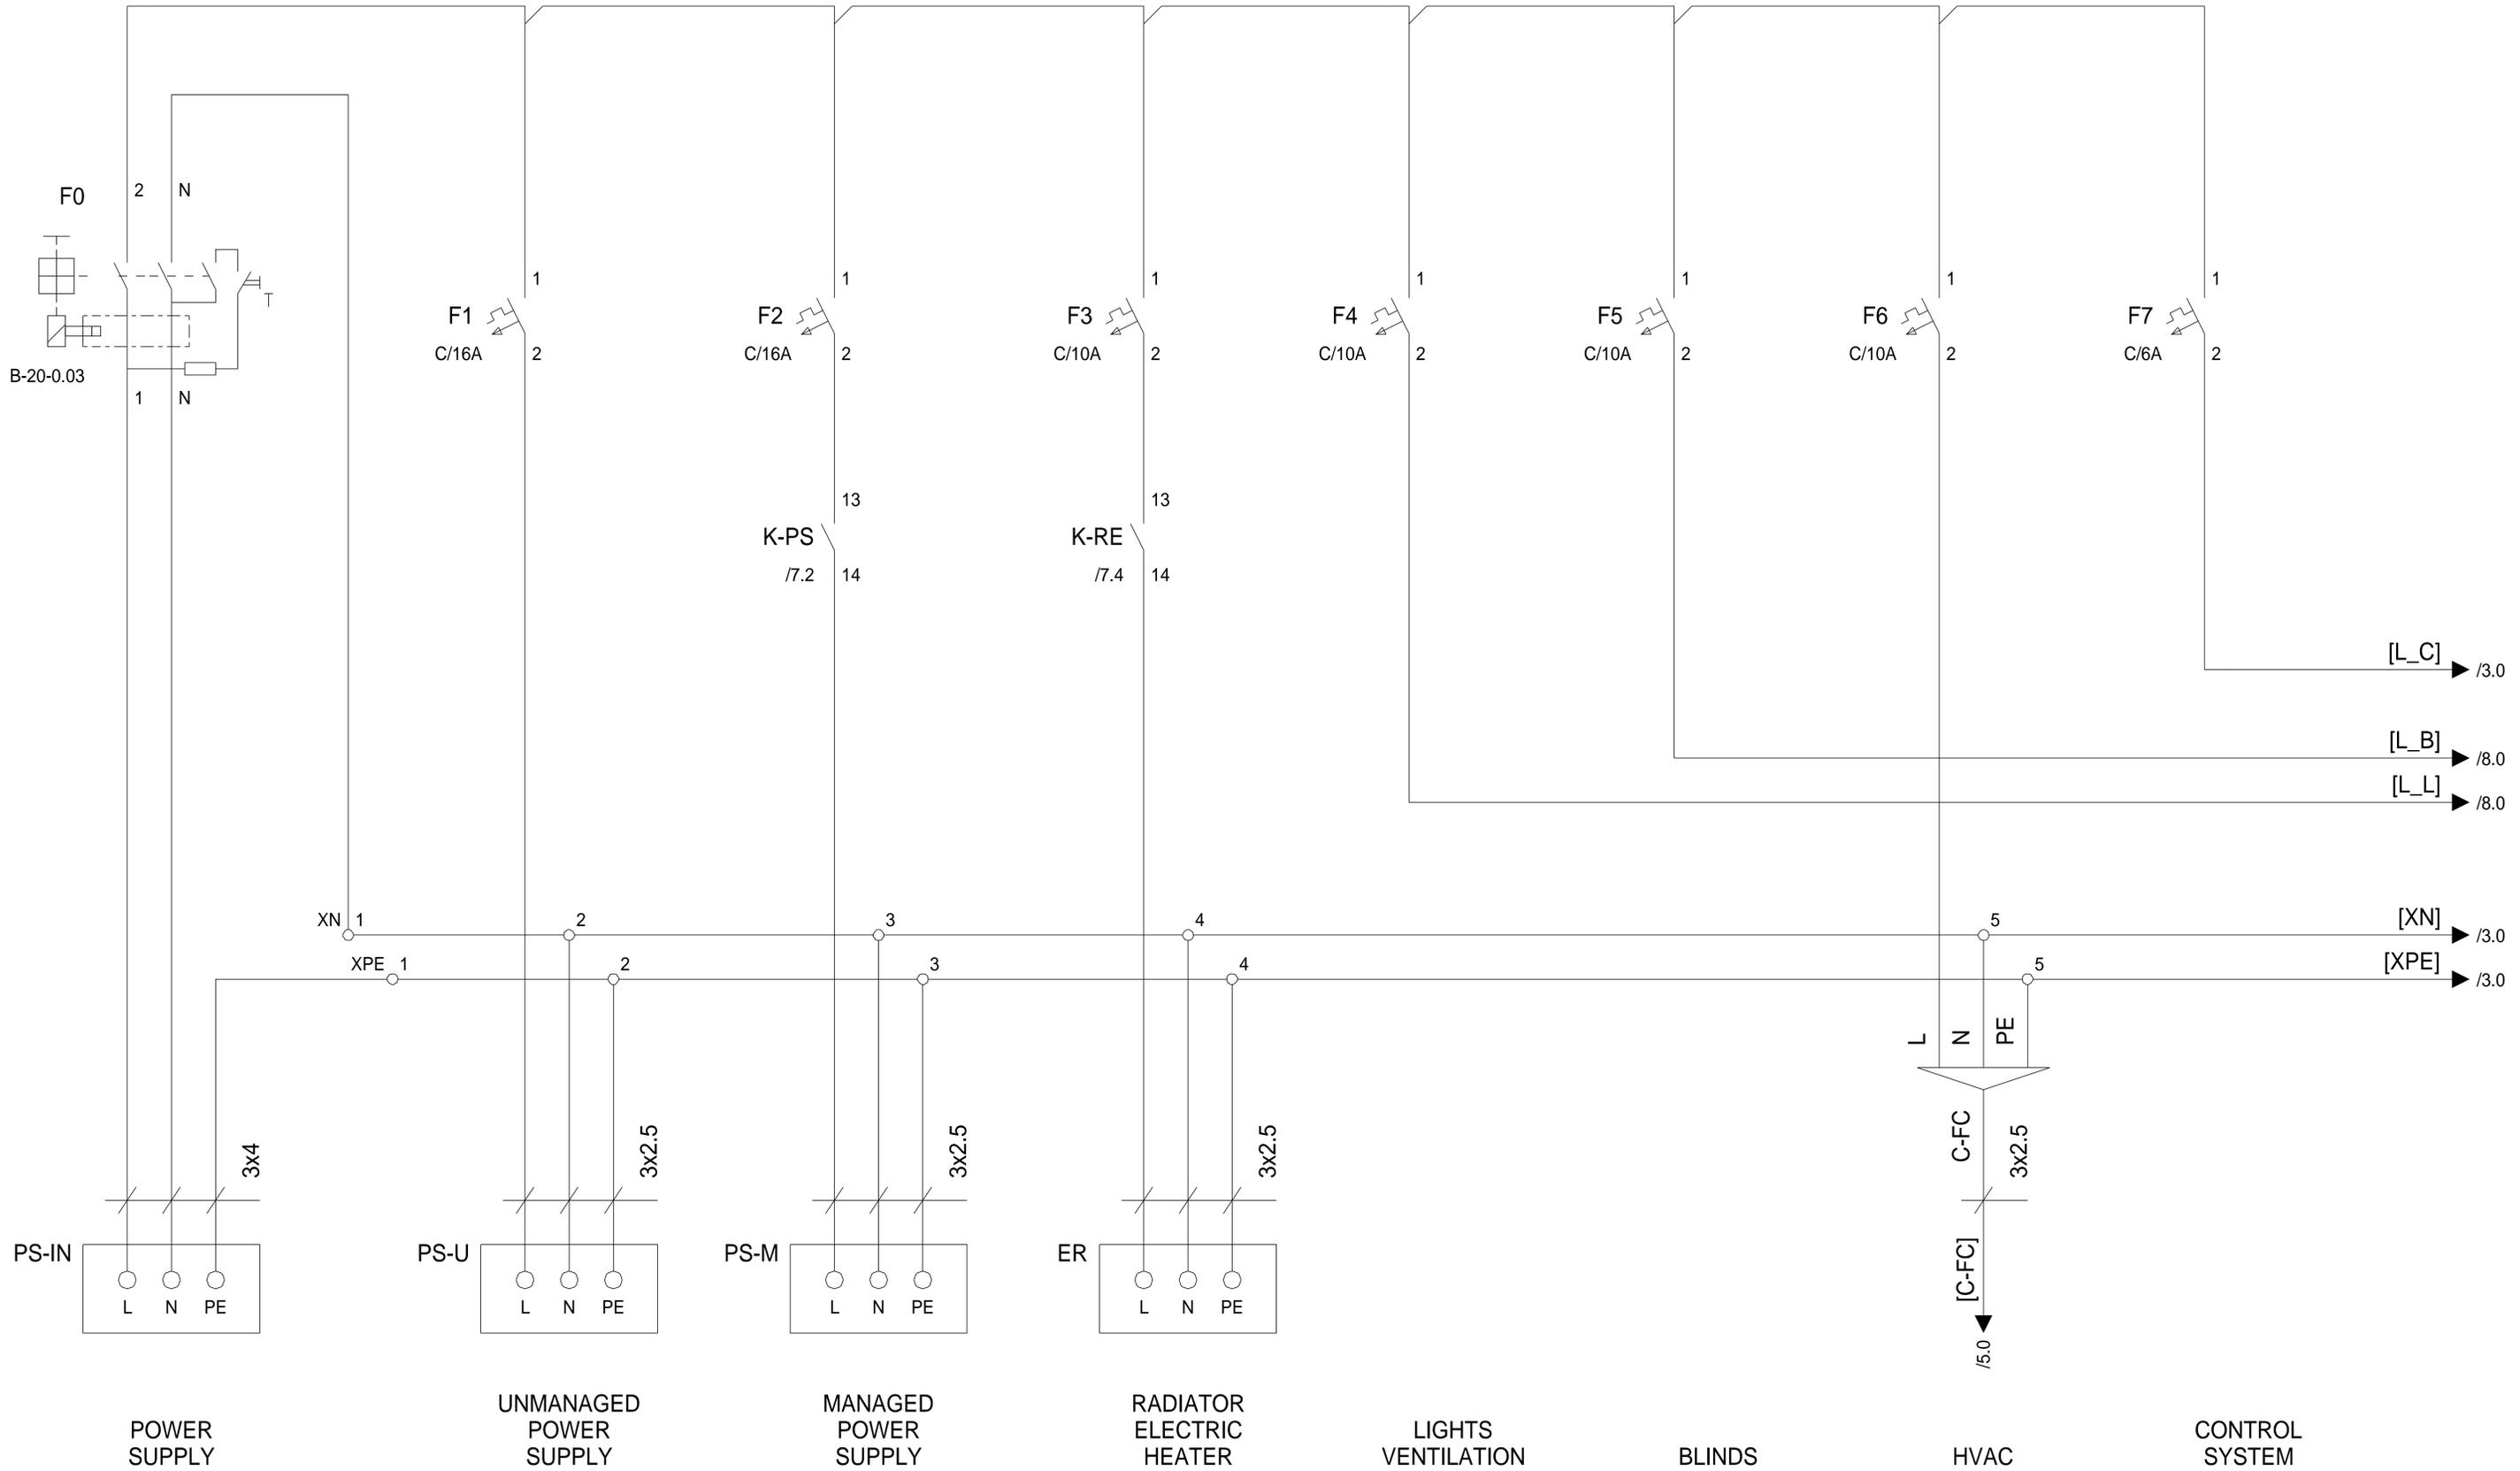

Rev	Revision text	Signature	Date	Last changed by KOCG Last changed 20/3/2026 Print date 20/3/2026	 Robotina d.o.o. OIC Kozina 38 SI-6240 Kozina	Guest Room Management System GRMS BASIC	Version 2.2.0 Pages 10	Installation = Location + Page number 2
-----	---------------	-----------	------	--	---	--	--	--

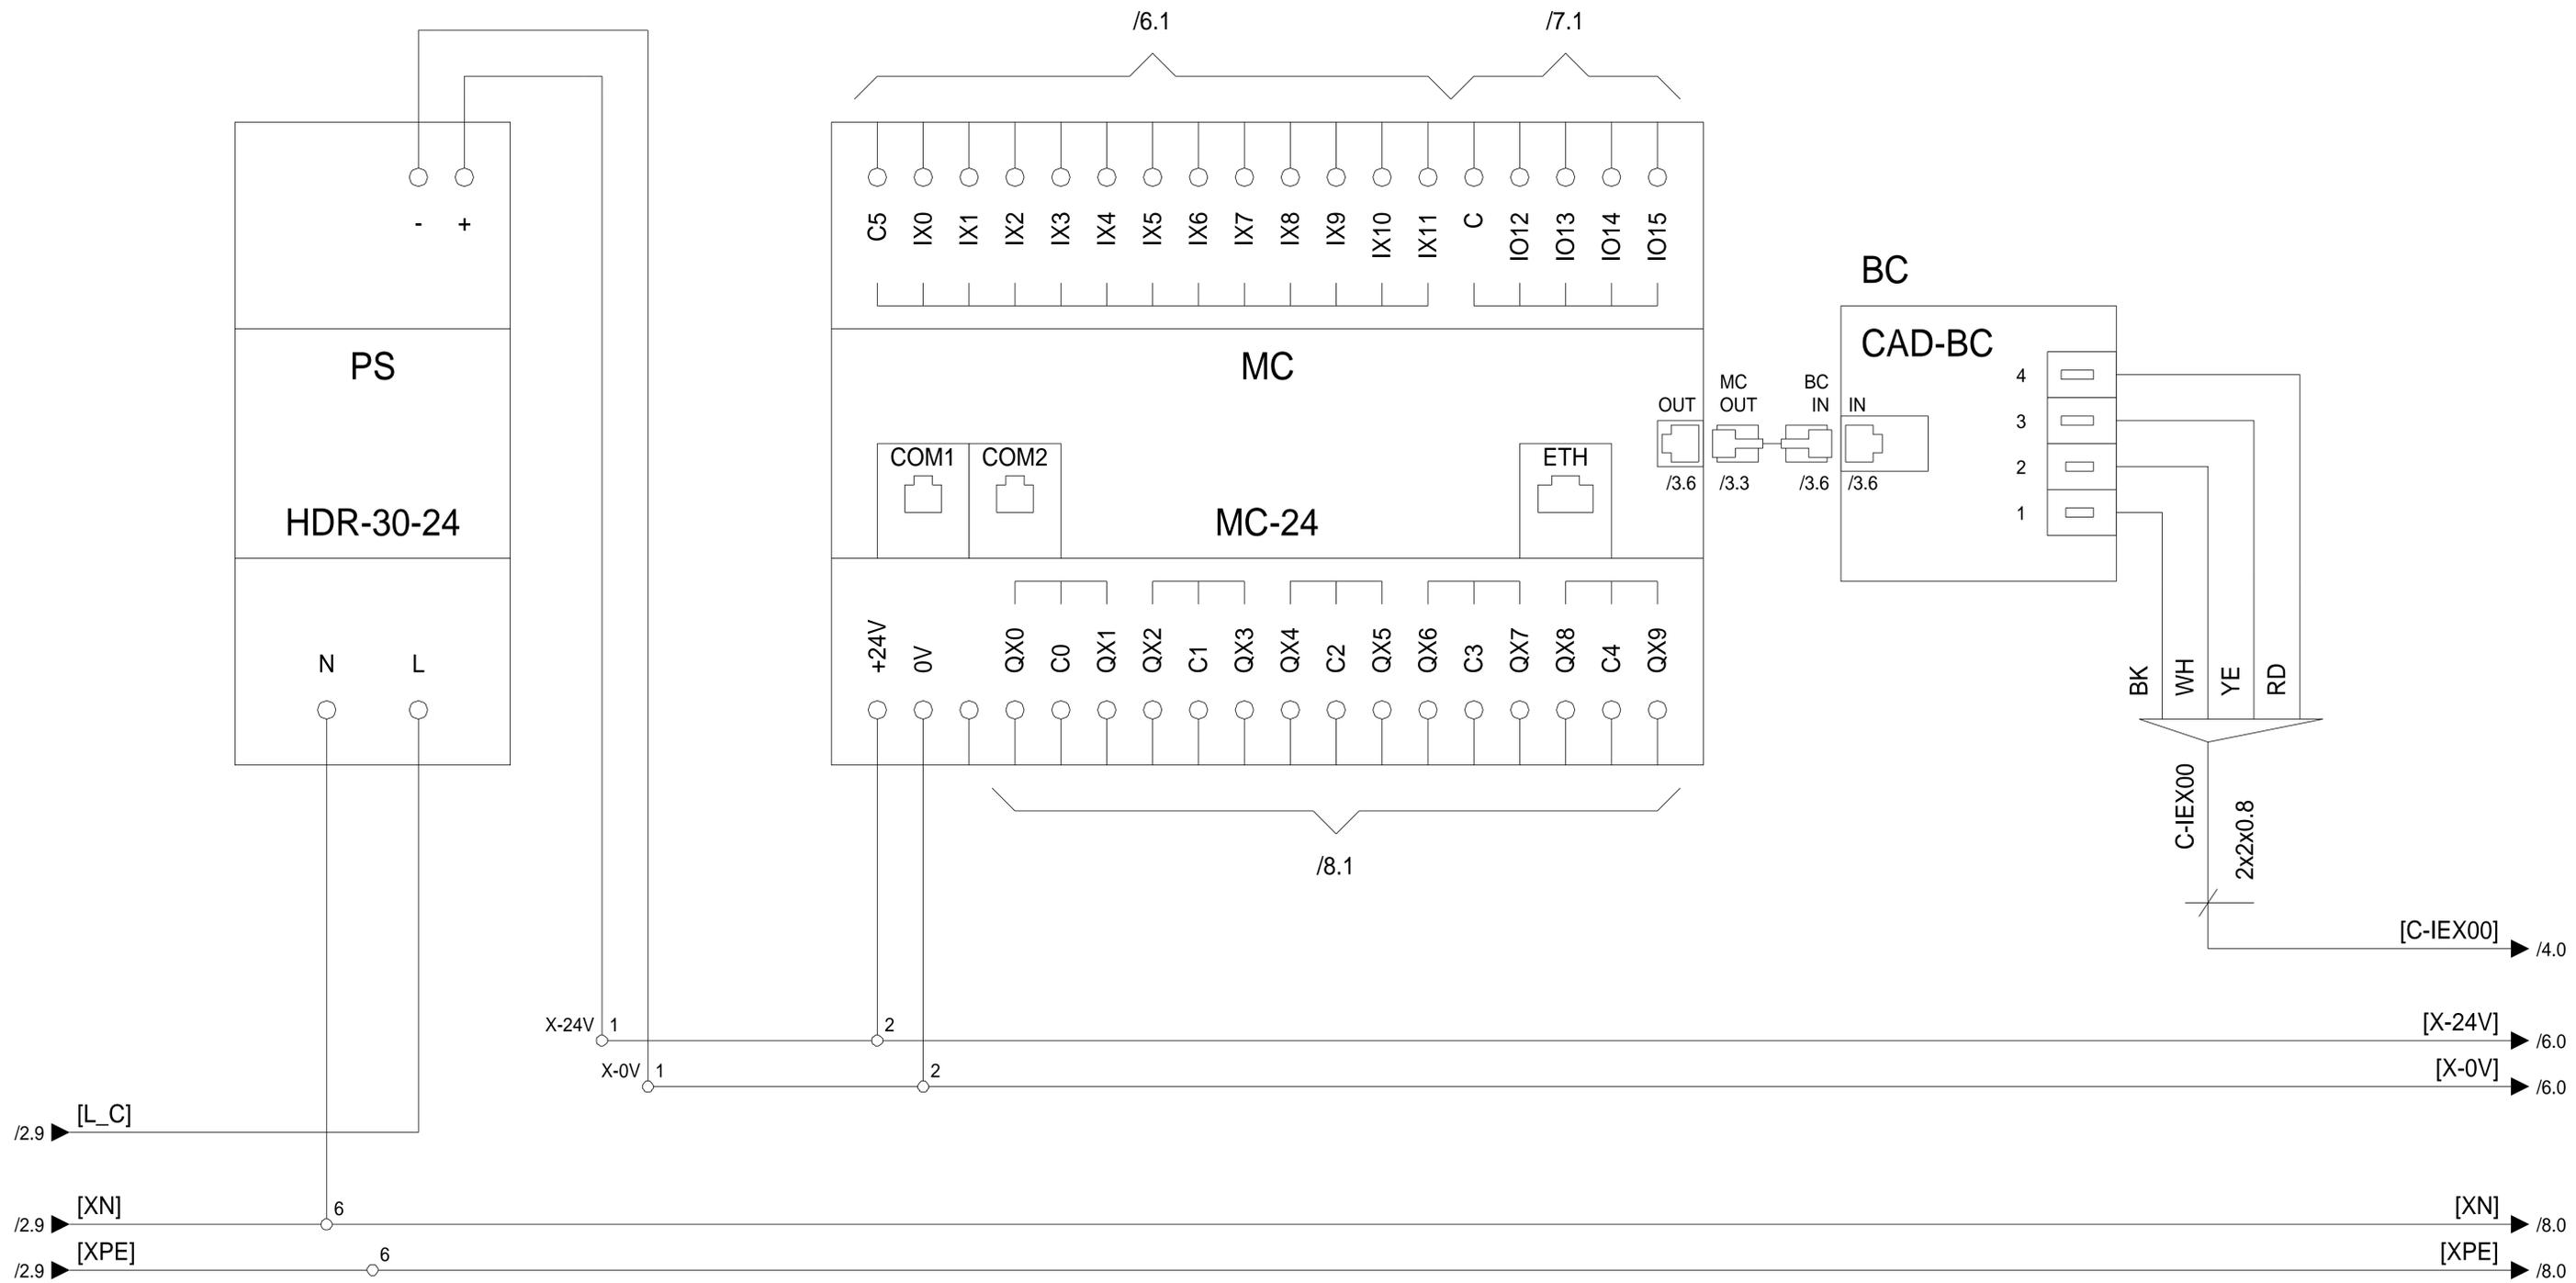

Rev	Revision text	Signature	Date	Last changed by KOCG Last changed 20/3/2026 Print date 20/3/2026	 Robotina d.o.o. OIC Kozina 38 SI-6240 Kozina	Guest Room Management System GRMS BASIC	Version 2.2.0 Pages 10	Installation = Location + Page number 3
-----	---------------	-----------	------	--	---	--	--	--

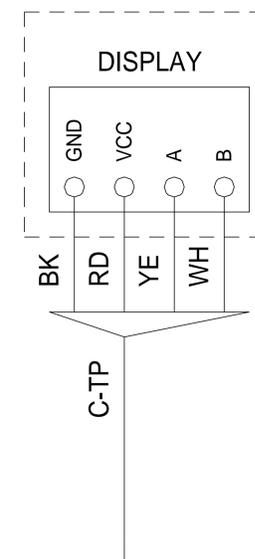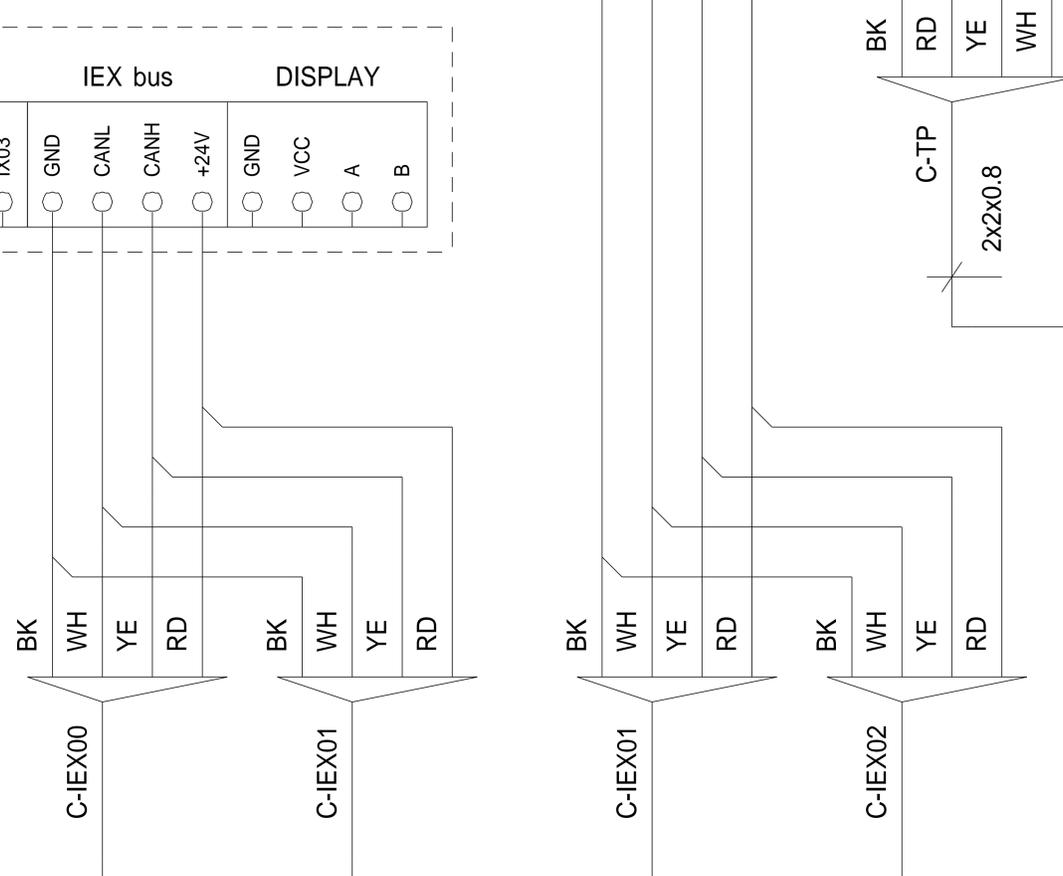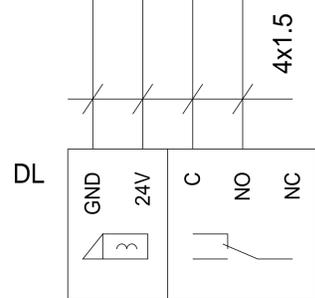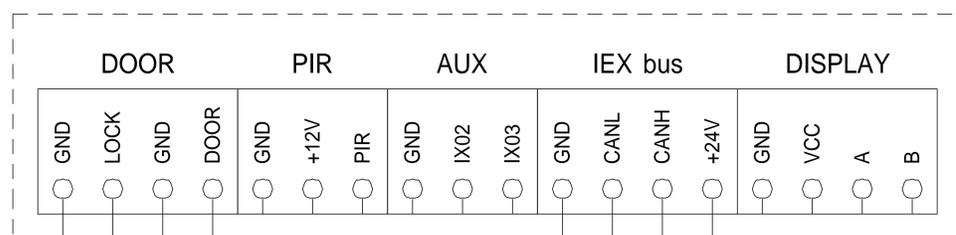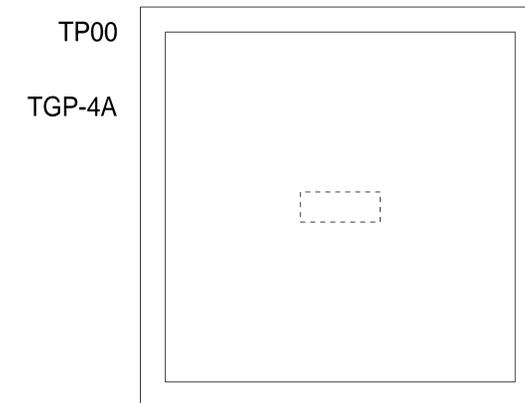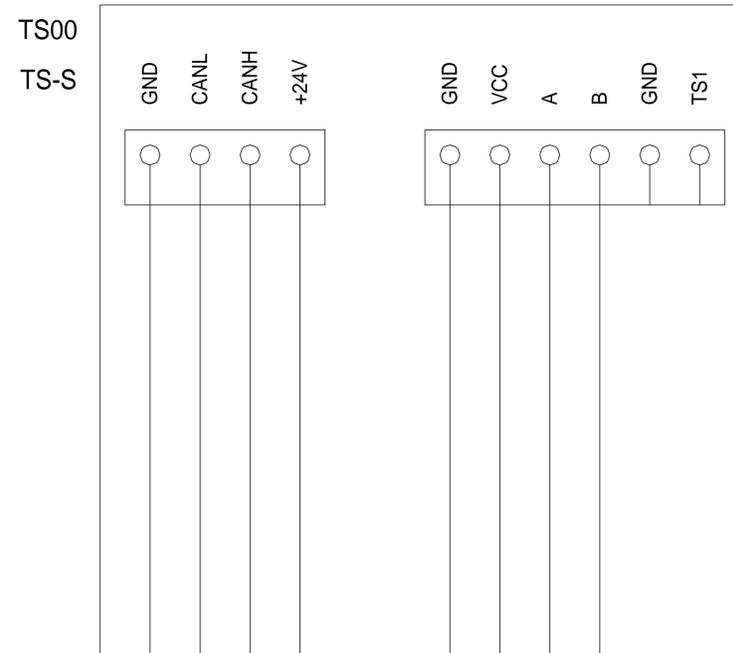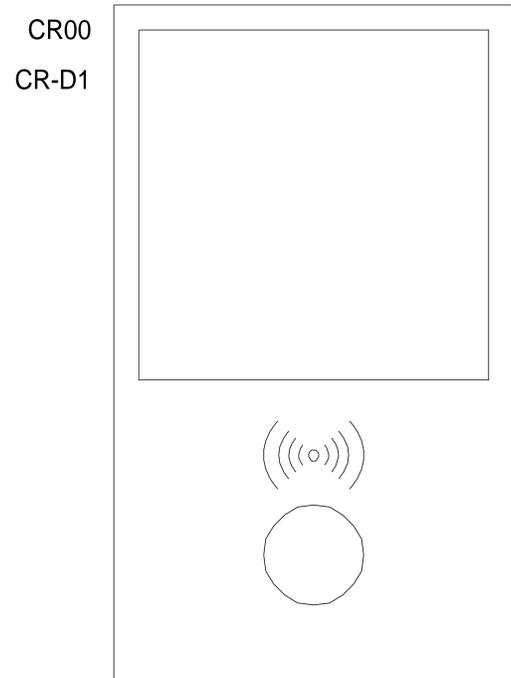

3.9 [C-IEX00]

[C-IEX02] 5.0

CORRIDOR

ROOM

ROOM

Rev	Revision text	Signature	Date
-----	---------------	-----------	------


Last changed by KOCG
Last changed 20/3/2026
Print date 20/3/2026



Guest Room Management System GRMS	BASIC
--------------------------------------	-------


Version	2.2.0
Pages	10

Installation	=
Location	+
Page number	4

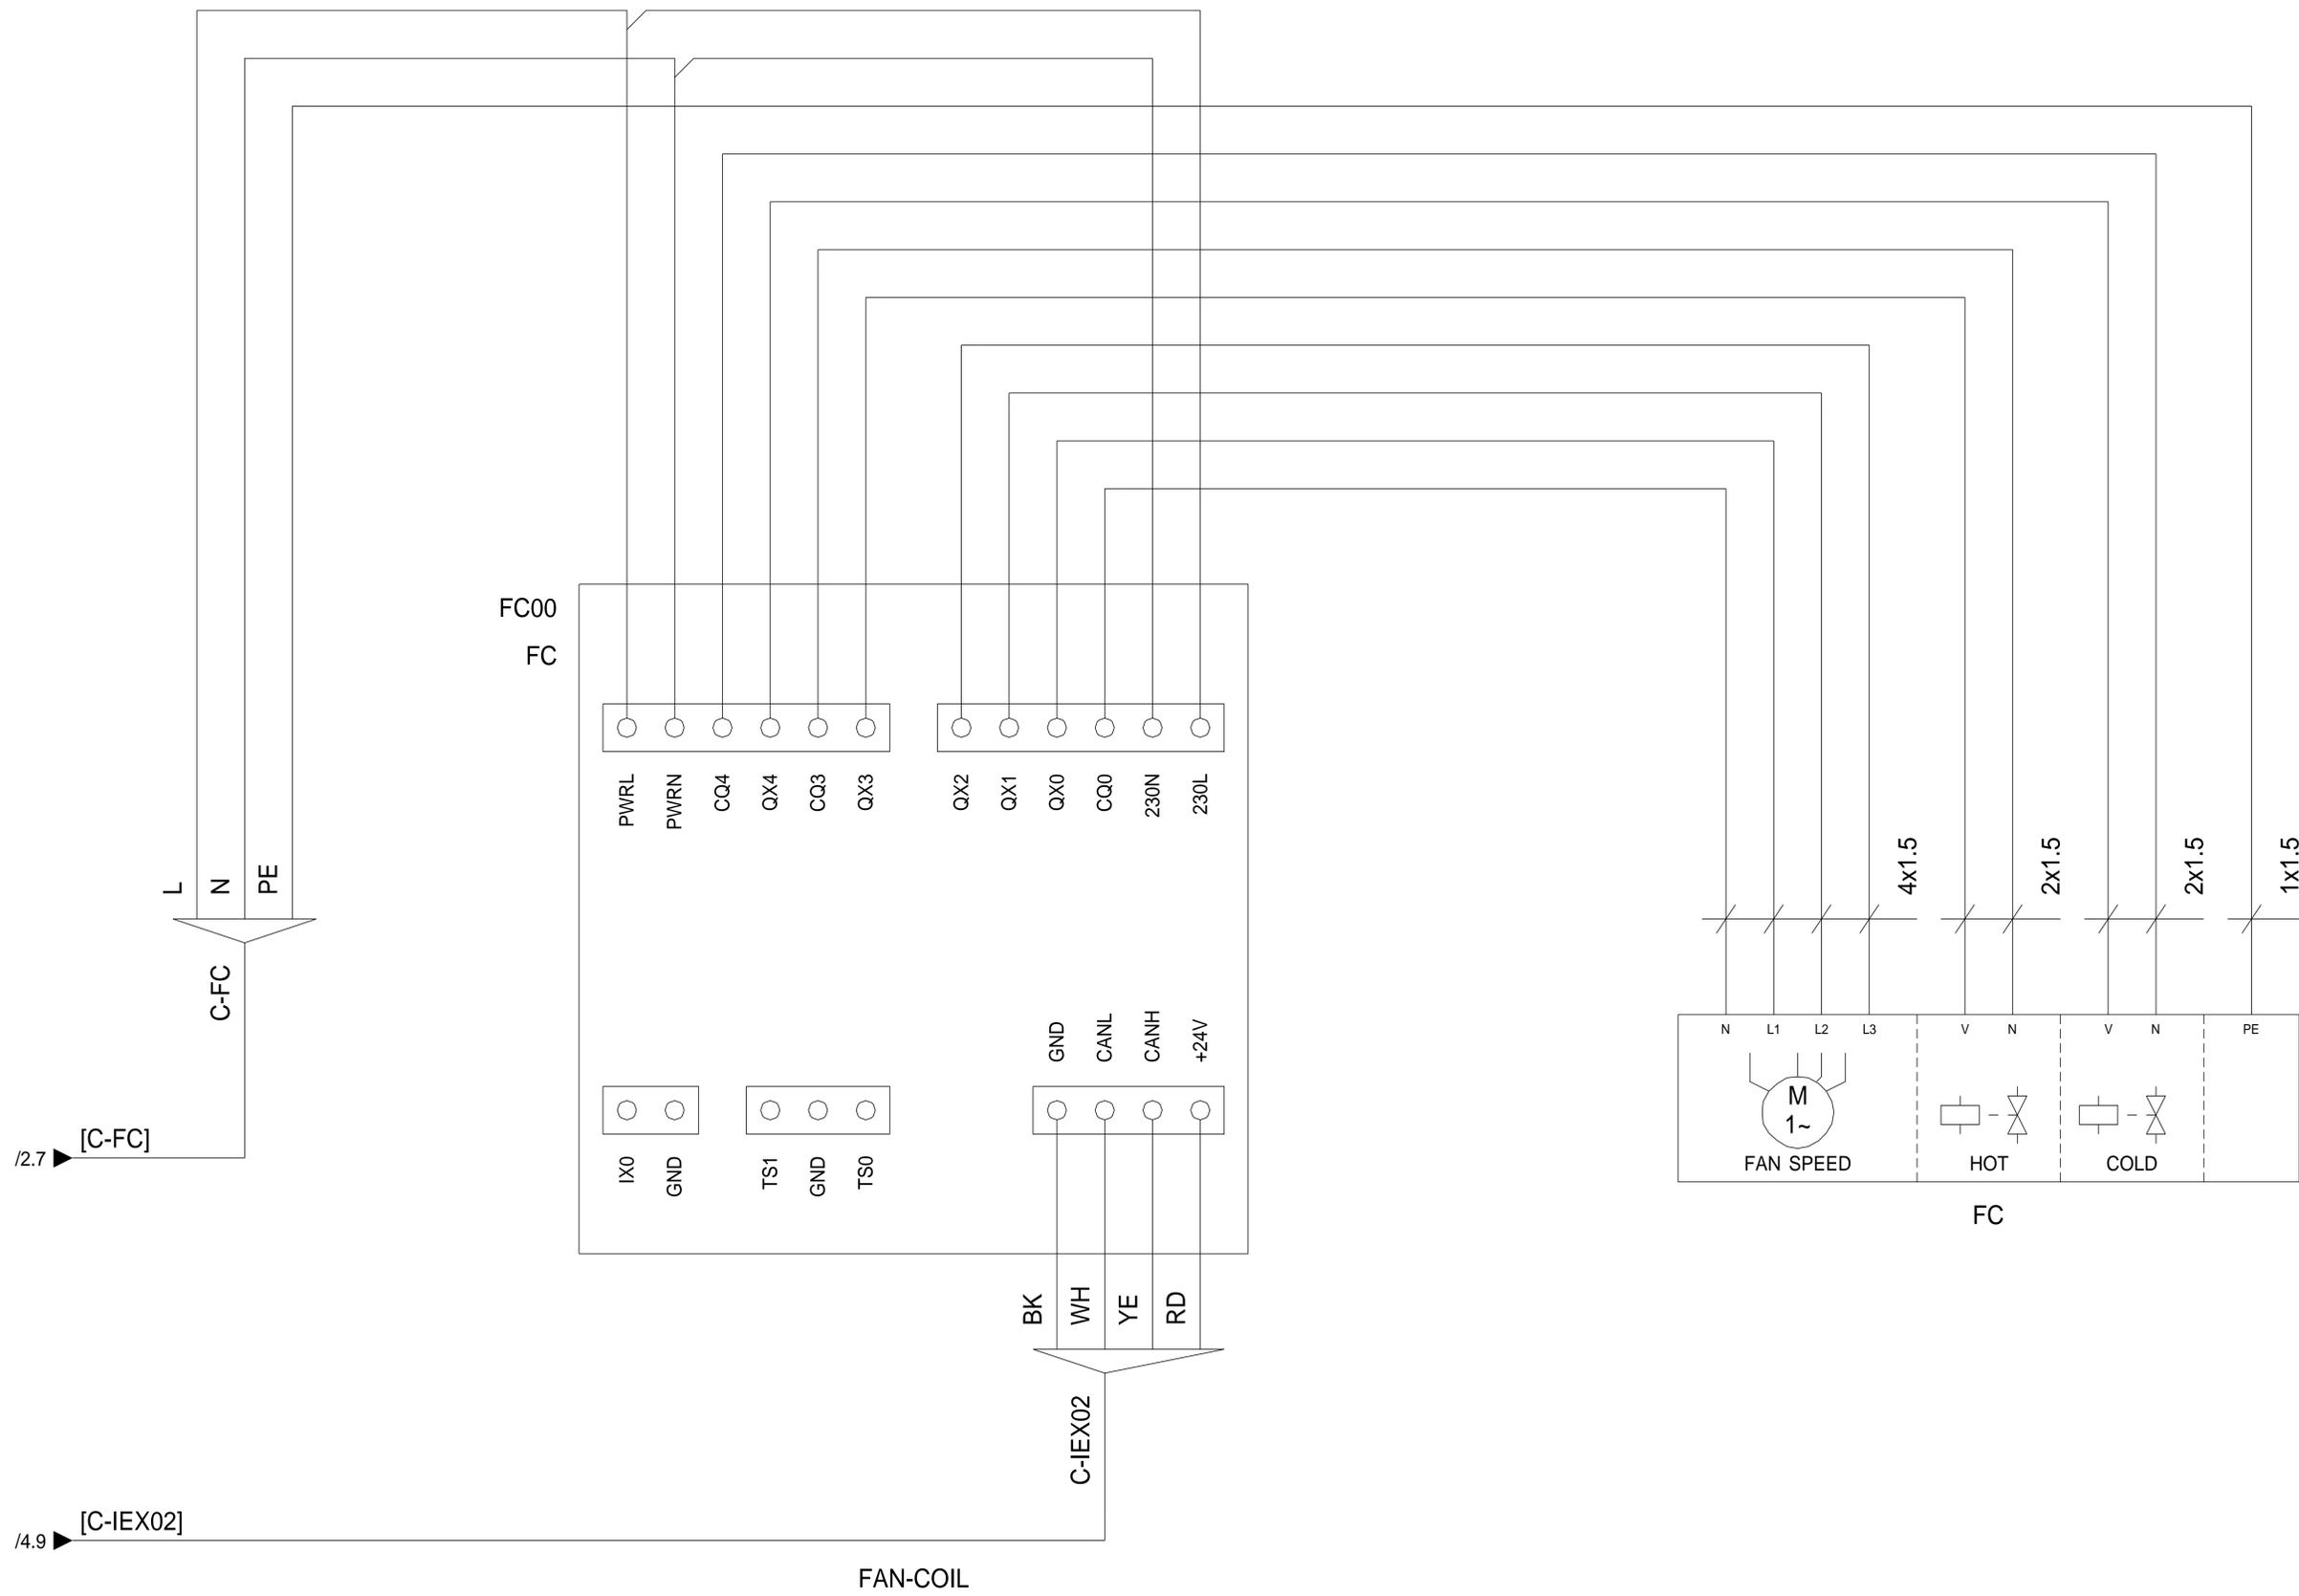


FAN-COIL


		Last changed by KOCG		 Robotina d.o.o. OIC Kozina 38 SI-6240 Kozina	Version 2.2.0		Installation =	
		Last changed 20/3/2026			Pages 10		Location +	
Rev	Revision text	Signature	Date		Print date 20/3/2026		Page number 5	
				Guest Room Management System GRMS BASIC				

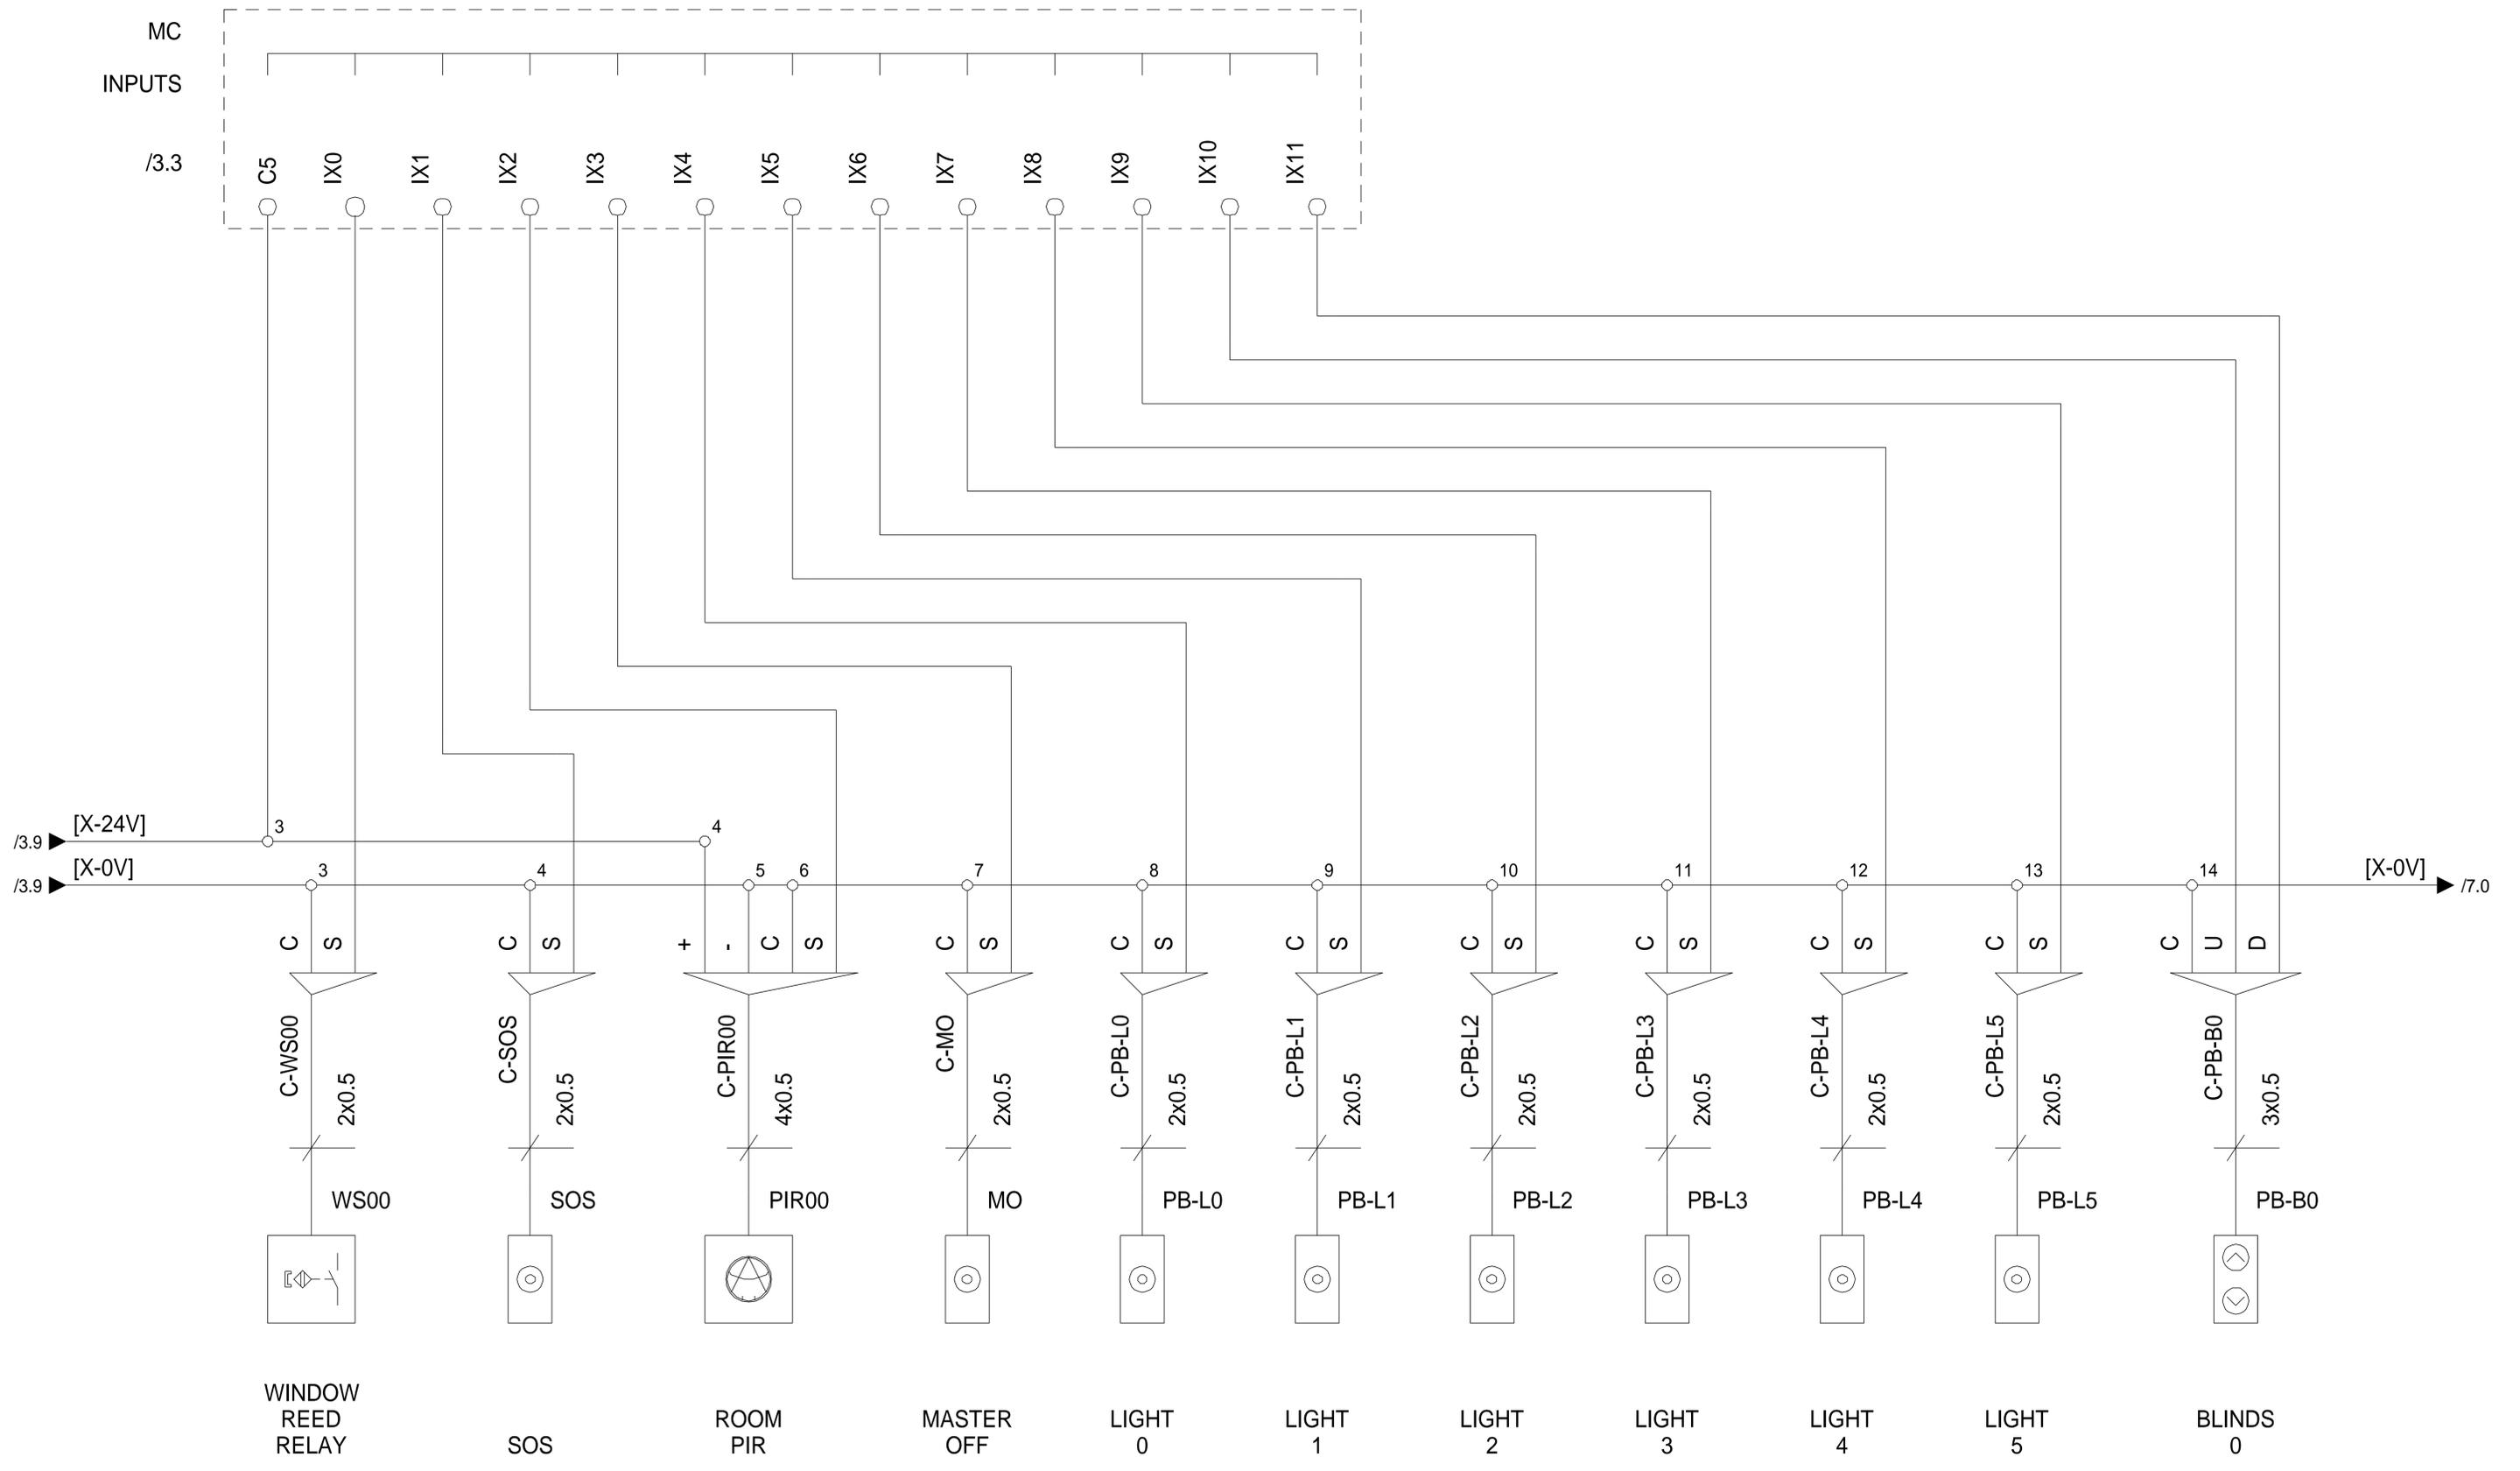


Rev		Revision text		Signature		Date		Last changed by KOCG Last changed 20/3/2026 Print date 20/3/2026		 Robotina d.o.o. OIC Kozina 38 SI-6240 Kozina		Guest Room Management System GRMS BASIC		Version 2.2.0 Pages 10		Installation = Location + Page number 6	
-----	--	---------------	--	-----------	--	------	--	--	--	---	--	--	--	---	--	--	--

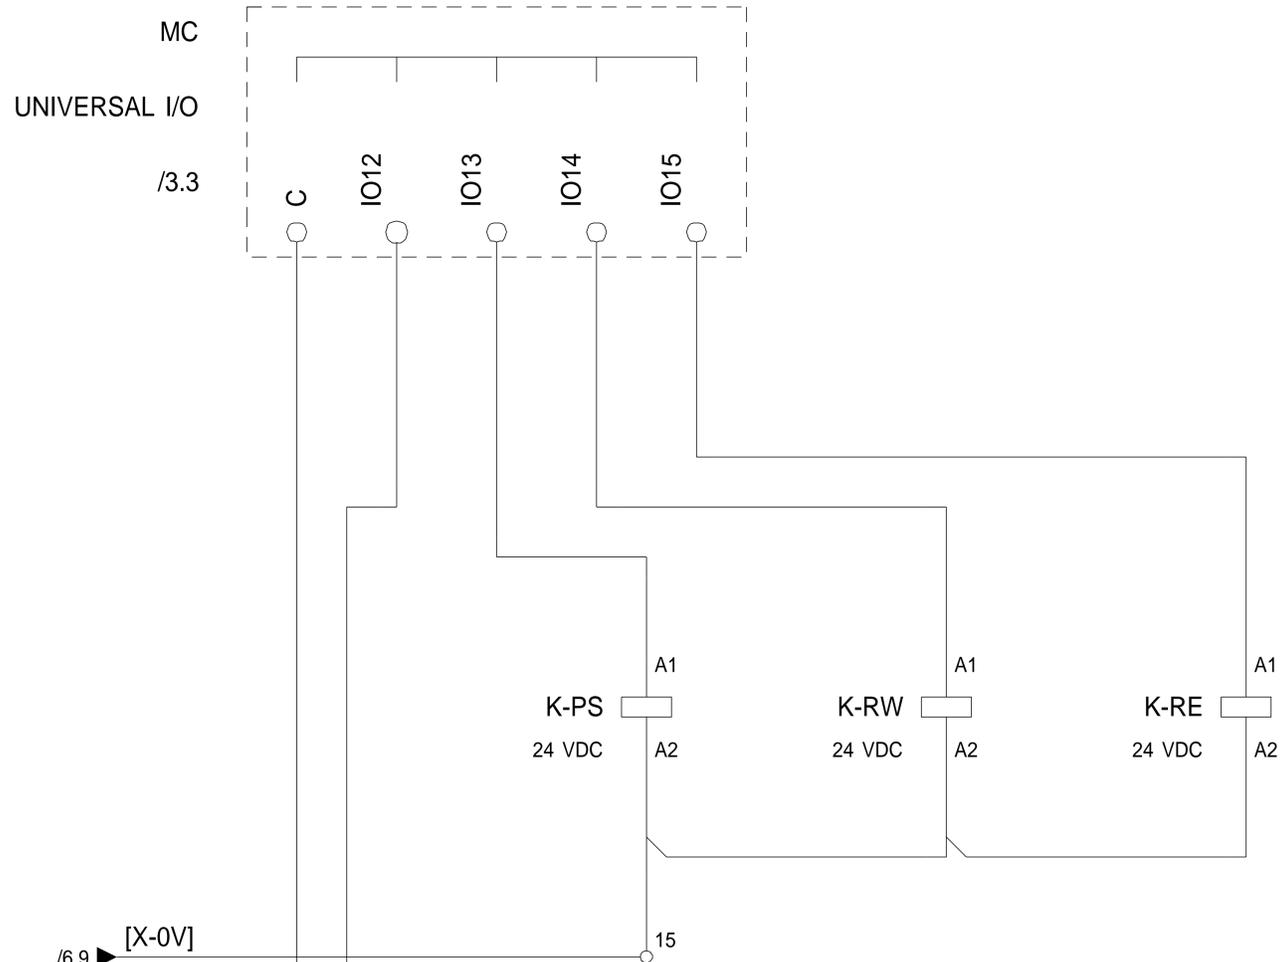


/6.9 [X-0V]

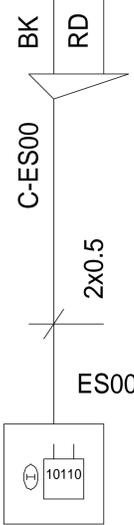


BATH TEMPERATURE



MANAGED POWER SUPPLY




RADIATOR HOT WATER VALVE




RADIATOR ELECTRIC HEATER

				Last changed by KOCG		 Robotina d.o.o. OIC Kozina 38 SI-6240 Kozina	Version 2.2.0		Installation =		
				Last changed 20/3/2026					Location +		
Rev		Revision text		Signature			Date		Print date 20/3/2026		Pages 10
							Guest Room Management System GRMS BASIC		Page number 7		

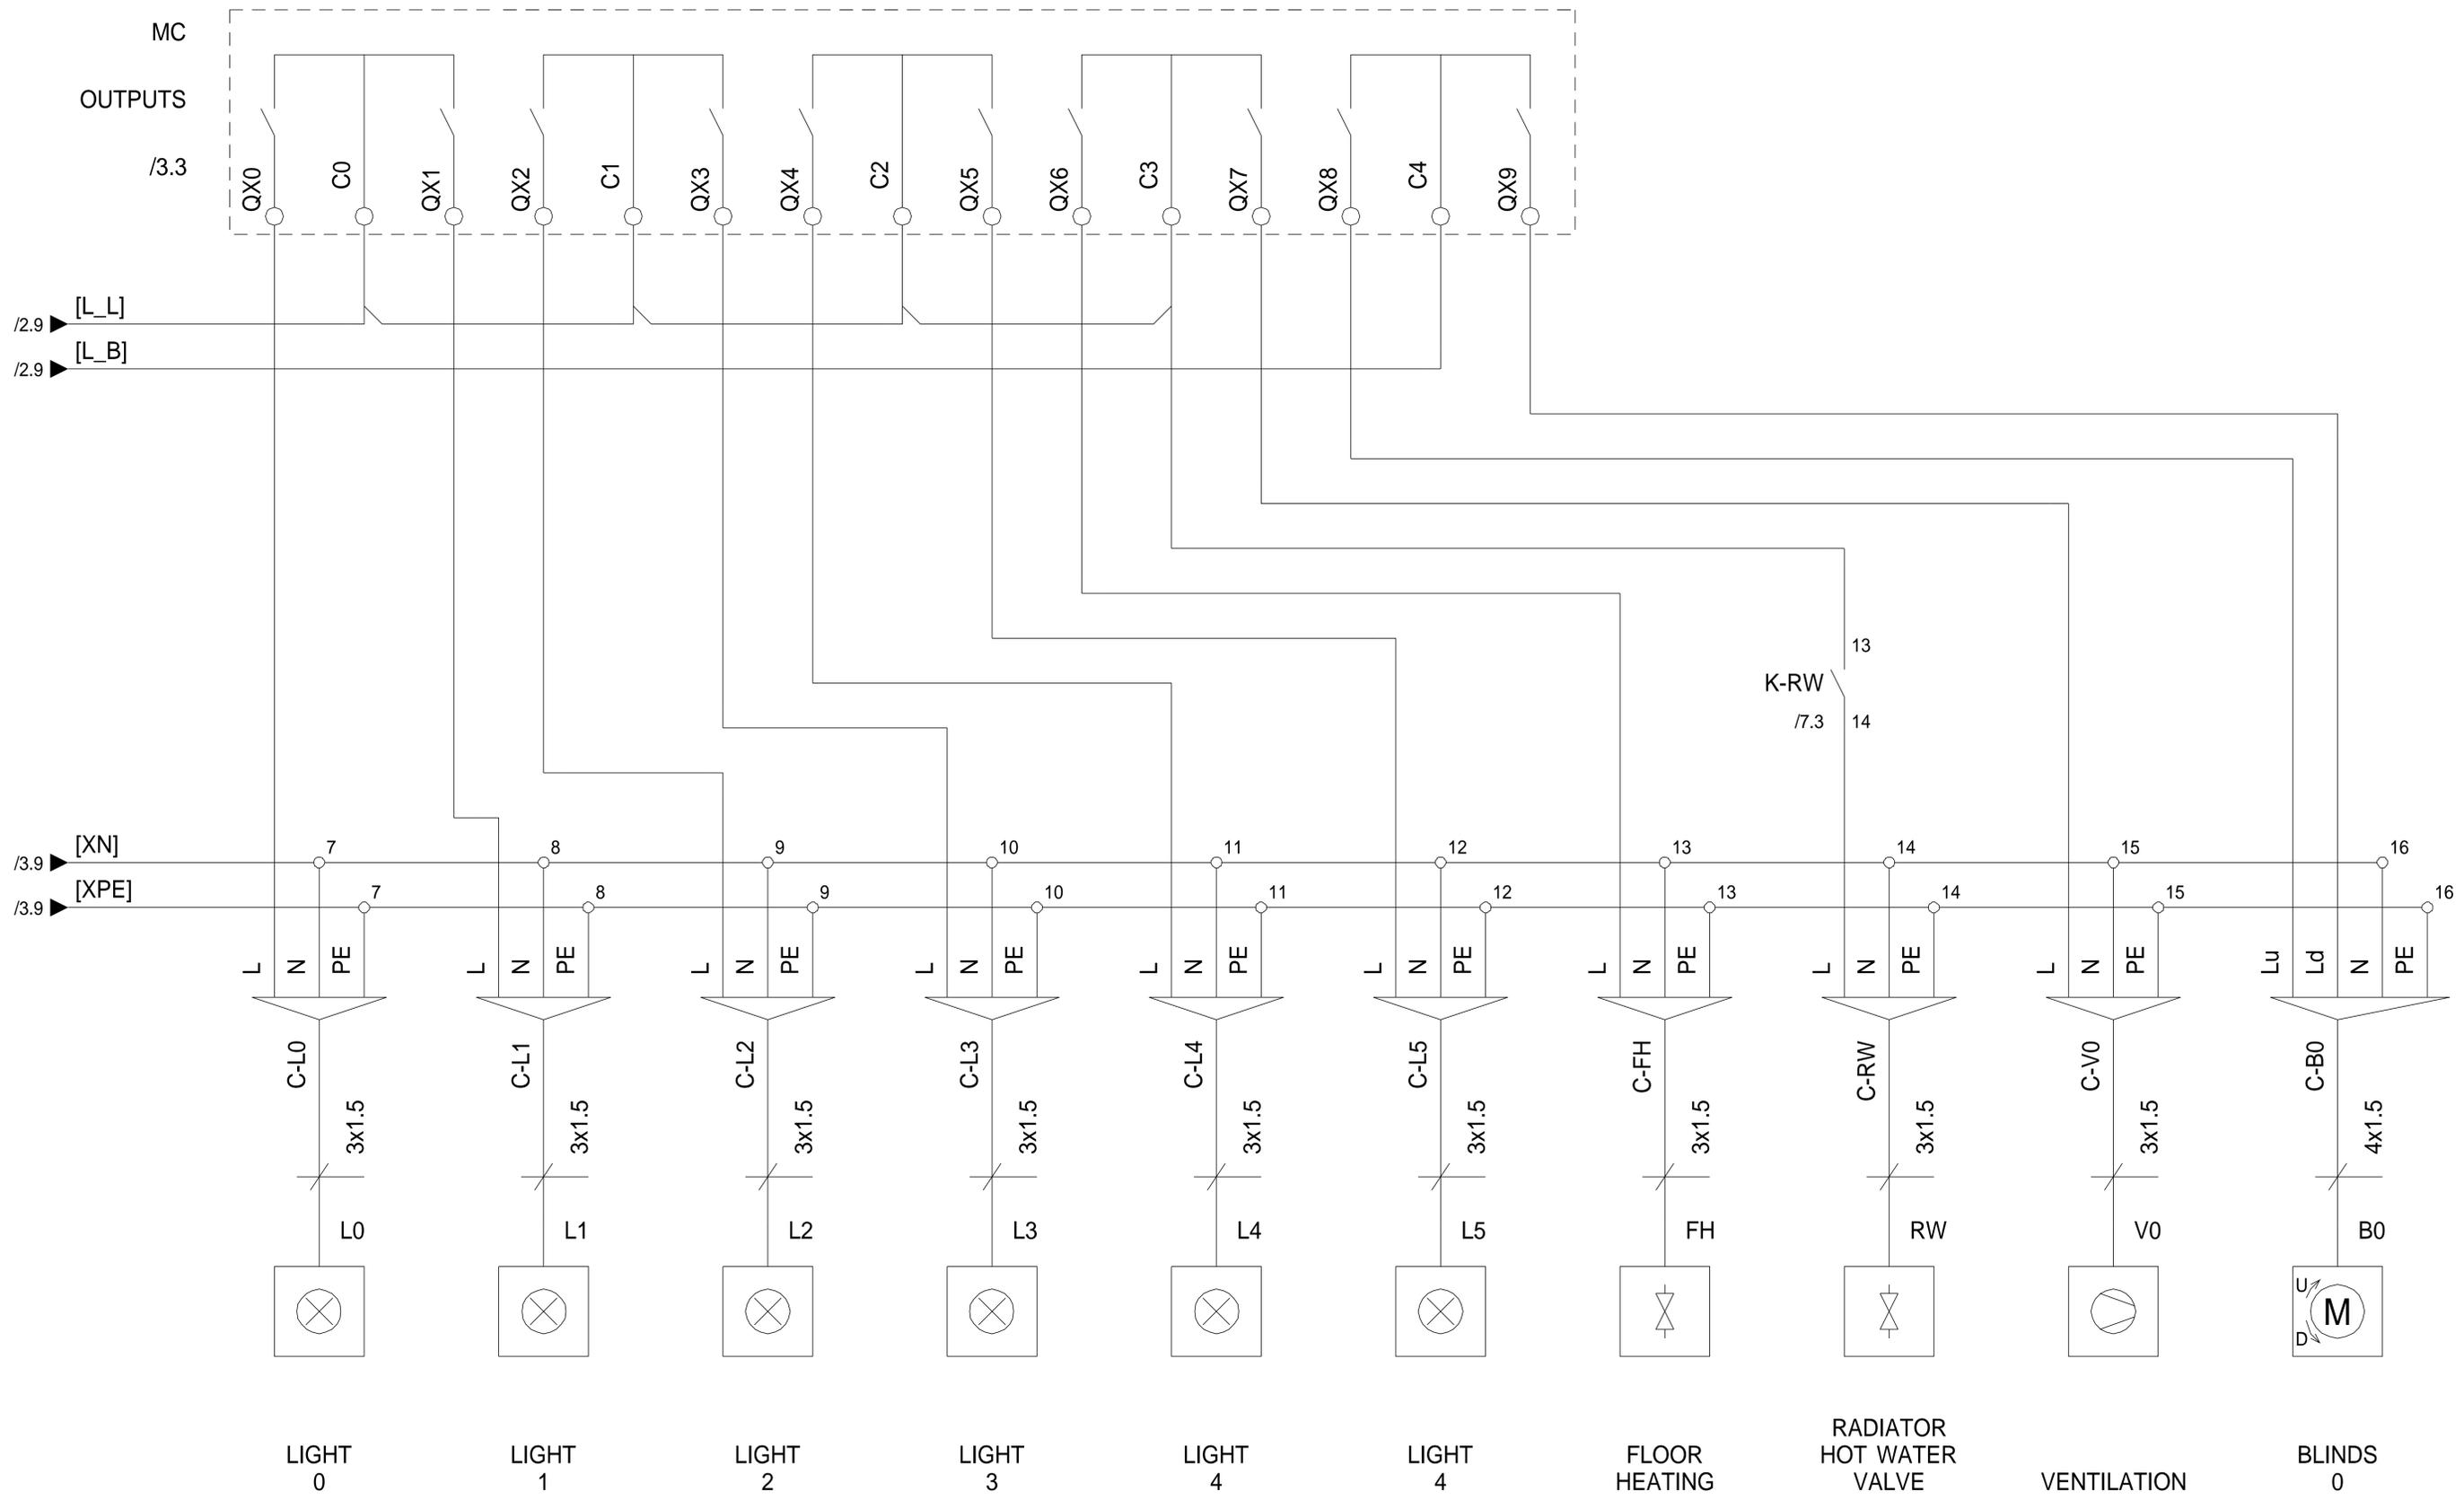

				Last changed by KOCG		 Robotina d.o.o. OIC Kozina 38 SI-6240 Kozina	Version 2.2.0		Installation =	
				Last changed 20/3/2026			Pages 10		Location +	
Rev	Revision text	Signature	Date	Print date 20/3/2026			Guest Room Management System GRMS BASIC		Page number 8	

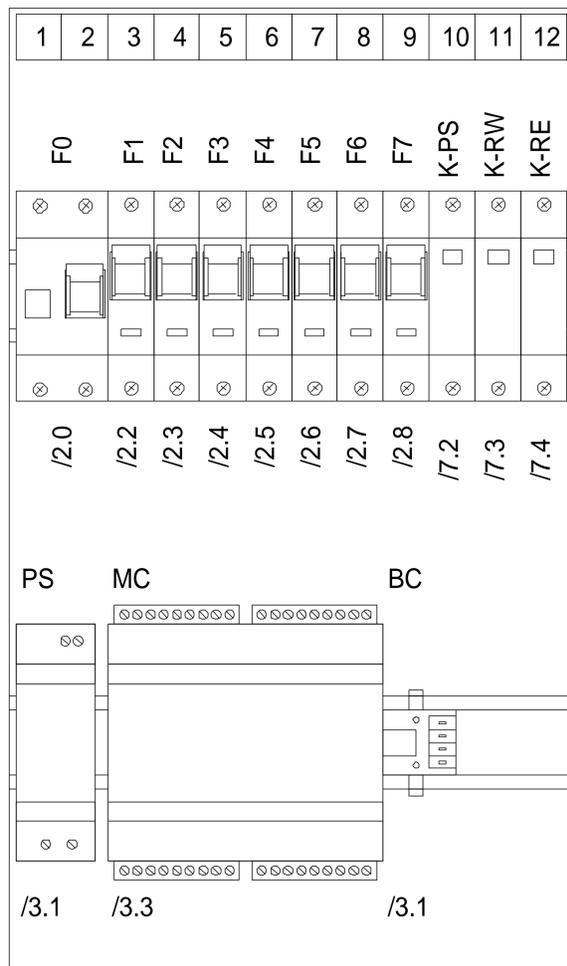


				Last changed by KOCG	 Robotina d.o.o. OIC Kozina 38 SI-6240 Kozina	Guest Room Management System GRMS BASIC	Version	Installation =
			Last changed 20/3/2026	2.2.0			Location +	
Rev	Revision text	Signature	Date	Print date 20/3/2026				

Facility LAN

S-RMS Linker

Control LAN

Master Controllers

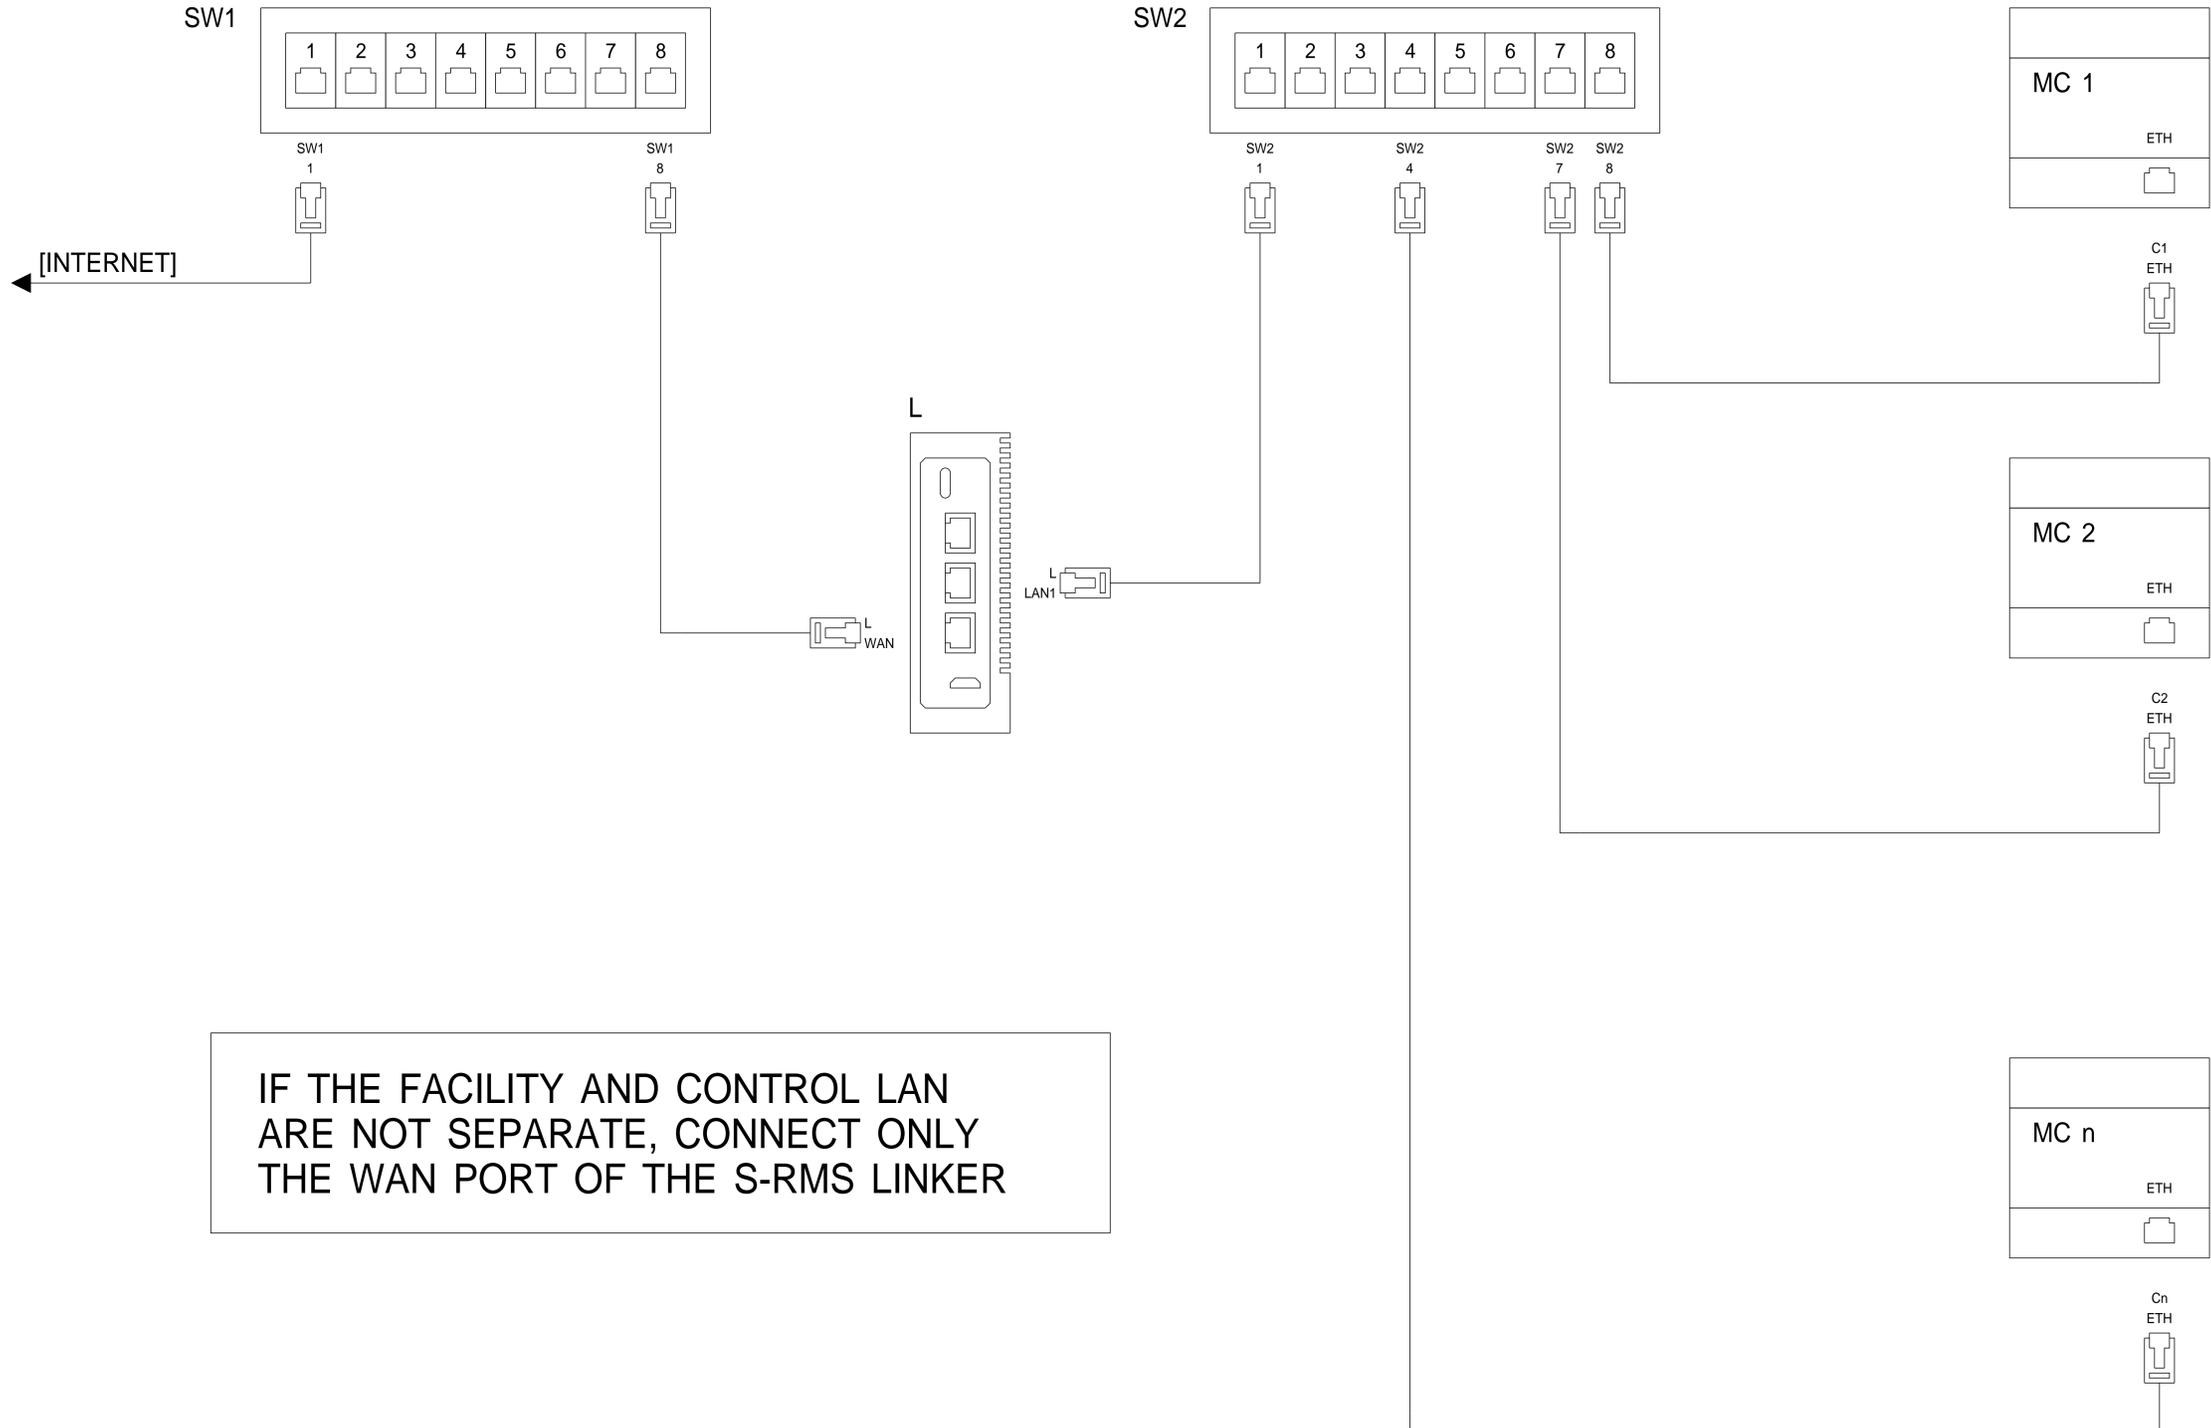

IF THE FACILITY AND CONTROL LAN ARE NOT SEPARATE, CONNECT ONLY THE WAN PORT OF THE S-RMS LINKER

				Last changed by KOCG	 Robotina d.o.o. OIC Kozina 38 SI-6240 Kozina	LAN Guest Room Management System GRMS BASIC	Version	Installation =
			Last changed 20/3/2026	2.2.0			Location +	
Rev	Revision text	Signature	Date	Print date 20/3/2026			Pages 10	Page number 10